

DATE: November 16, 2023

MEMO TO: All Plan Holders on Record

FROM: Ashe Broussard Weinzettle Architects LLP

Project: New Student Success Center
LSU at Alexandria
State Project No. 19-602-21-01
WBS No. F.19002361
Architect's Project Number 2021.58

RE: Addendum Number One (1)

The following additions, deletions, changes, supplemental information or clarifications are hereby made part of the Contract Documents for the above referenced project:

1. APPROVED EQUAL:
 - a. Specifications, Section 10 80 00, Specialties/Miscellaneous, 2.12 Motorized Window Shades
 - b. SWF Contract, Motorized Flex Shade is an approved equal, with programmable RTS controls.
2. APPROVED EQUAL:
 - a. Specifications, Section 08 14 00, Wood Doors, 2.2.E, Acceptable Manufacturers
 - b. Oshkosh Door Company, factory finished, standard manufacturer color chart
3. Re: SPECIFICATIONS, Section 10 82 13, Roof Screens –
 - a. Paragraph 1.2
 1. Change 05 31 13 to 05 31 00.
 2. Change 09 91 00 to 09 90 00.
 - b. Paragraph 1.10
 1. Delete Item C.
4. Re: DRAWINGS, Detail 3/A131, Section – Equipment Screen –
 - a. See revised drawing, dated 11.10.23, accompanying addendum.
5. Re: SPECIFICATIONS, Section 10 80 00, Specialties/Miscellaneous, Item 2.12 Motorized Window Shades:
 - a. Shade Fabric, openness:
 1. Windows facing east and west – 1%
 2. Windows facing north – 5%
 - b. Provide both wall switch control and remote control of shades.
6. Re: SPECIFICATIONS, Section 10 80 00, Specialties/Miscellaneous, Item 2.13, Window Blinds
 - a. Item A –
 1. Change cordless to corded.
 2. Change 2 ½" to 2 ½" or 2".
 3. Change handrail to headrail.
 - b. Item B – at Contractor option, change cordless to corded.
 - c. Add the following requirements:
 1. Manufacturer shall add their standard spring lift mechanisms to all shades which weigh more than 10 lbs., or as per manufacturer recommendations.
 2. As per manufacturer requirements, at windows which exceed max. width limit, provide sections of blinds, equally spaced within window opening.

- d. Add the following (includes all numbered windows contained within letter group)
The following windows shall not receive blinds:
 1. First Floor Exterior:
 - a. N-t @ end of HALL 134-A
 - b. A @ STAFF 119
 - c. T, U, V, W, X, Y, BB, GG, KK
 2. Second Floor Exterior:
 - a. AA @ end of HALL 239
 - b. N-t @ end of HALL 209
 - c. A and A-t @ STAIR 03/S203
 - d. E, F, G, T, Y, FF, GG, KK
 3. First Floor Interior (includes all "-int" associated with letter group):
 - a. A @ WORKROOM 135
 - b. A-t @ STAFF 128
 - c. A-t @ CLASSROOM 149
 - d. A and A-t @ WORKROOM 152
 - e. C, D, E, H, K, N, J, T
 4. Second Floor Interior (includes all "-int" associated with letter group):
 - a. H, P, Q
7. APPROVED EQUAL:
 - a. Specifications, Section 10 80 00, Specialties/Miscellaneous, 2.13 Window Blinds
 - b. SWF Contract, Faux Wood.
8. Re: SPECIFICATIONS, Section 09 95 00, High Performance Coating, 3.5 EXTERIOR PAINTING:
 - a. Change item B. to read as follows:


"B. Approved equal: Benjamin Moore"

 1. Shop Coat: Corotech Acrylic Metal Premier V110
 2. Field Touch-up: Corotech Acrylic Metal Premier V110
 3. 1st Field Coat: Corotech Epoxy Mastic Coating V160
 4. 2nd Field Coat: Corotech Aliphatic Acrylic Urethane V500
 - b. Add item C as follows:

"C. Approved equal: Sherwin Williams"

 1. Shop Coat: S-W Corothane 1 Galvapak 1K, B65 (3.0-4.0 dry mils)
 2. Field Touch-up: S-W Corothane 1 Galvapak 1K, B65 (3.0-4.0 dry mils)
 3. 1st Field Coat: S-W Macropoxy 646 Fast Cure Epoxy, B58 (5.0-7.0 dry mils)
 4. 2nd Field Coat: S-W Acrolon 218 HS Polyurethane B65 (3.0-4.0 dry mils)
9. APPROVED EQUAL:
 - a. Specifications, Section 08 12 14, Standard Hollow Metal Frames
 - b. Curries/Assa Abloy
10. APPROVED EQUAL:
 - a. Specifications, Section 08 13 14, Standard Hollow Metal Doors
 - b. Curries/Assa Abloy
11. RE: DRAWINGS
 - a. Sheet A405, change the following window marks @218/219
 1. V.5 to V.3
 2. V.6 to V.4
 3. V.7 to V.5
 4. V.8 to V.6
 5. V.9 to V.7

End of Addendum Number One (1)

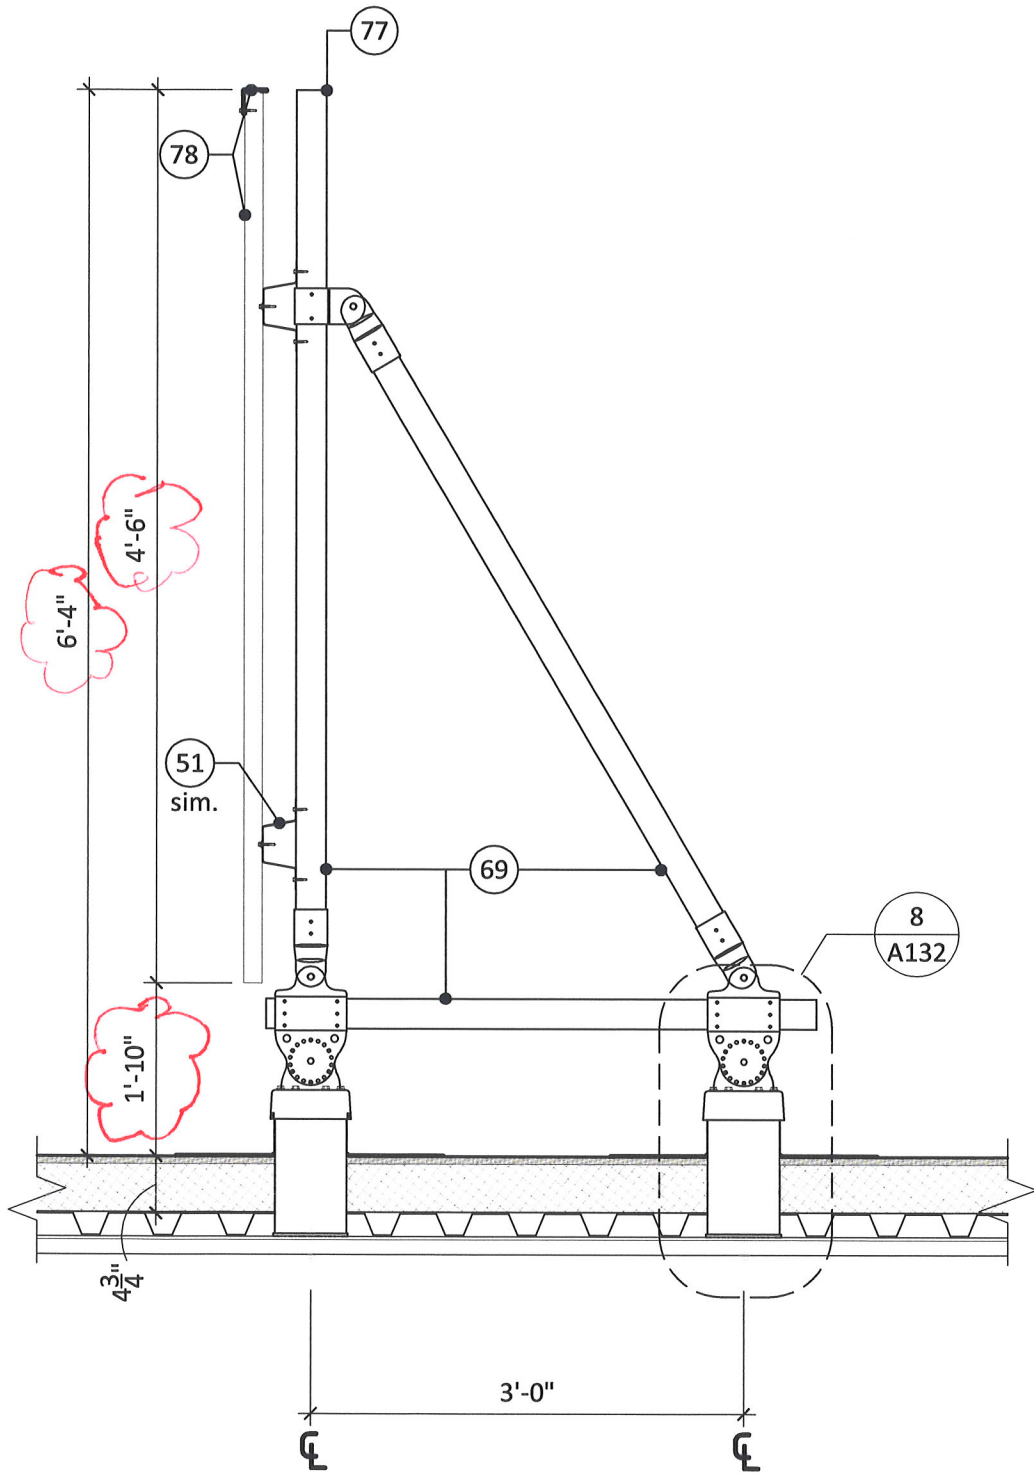

3
A131 | A131

SECTION - EQUIPMENT SCREEN

SCALE: 3/4" = 1'-0"

ADD. ALT. #3